


Did You Know?

South Australian Power Networks has published a complete rewrite of their "Service And Installation Rules" as of May 2022

There are new requirements regarding cable covers on service installations

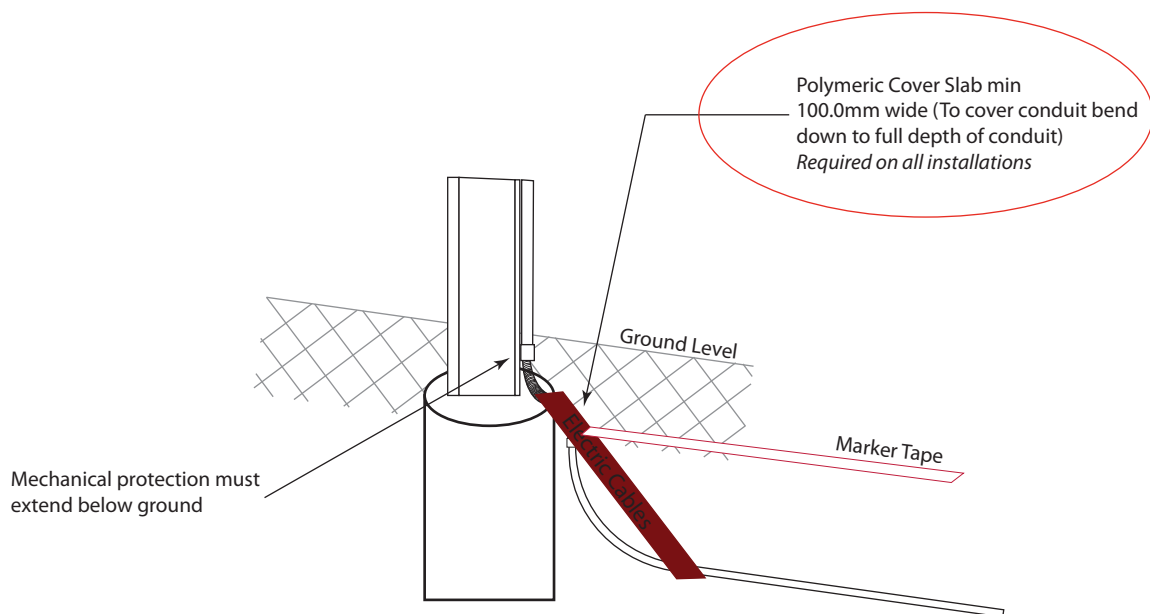

To Complement our range of service fuse connection kits

Part Number	Description	Length (M)
SFKTCC0554	Service Feed Foundation Cover Suit SAPN Install Requirements	1.0
SFKT0554	Service Fuse Connection Kit Single Phase 25.0mm	0.9
SFKT0556	Service Fuse Connection Kit Three Phase 32.0mm	0.9
SFKT0557	Service Fuse Connection Kit Three Phase 40.0mm	0.9
SFKT0558	Service Fuse Connection Kit Three Phase 50.0mm	0.9

UL, UR, cUL, cUR, cULus and cURus are registered certification marks of UL LLC.

WARNING

Noremak products shall be installed and used only as indicated in Noremak's product instruction sheets and training materials. Instruction sheets are available at www.noremak.com.au and from your Noremak customer service representative. Improper installation, misuse, misapplication or other failure to completely follow Noremak's instructions and warnings may cause product malfunction, property damage, serious bodily injury and death and/or void your warranty.

© 2020 Noremak All rights reserved

All other trademarks are the property of their respective owners. Noremak reserves the right to change specifications without prior notice.